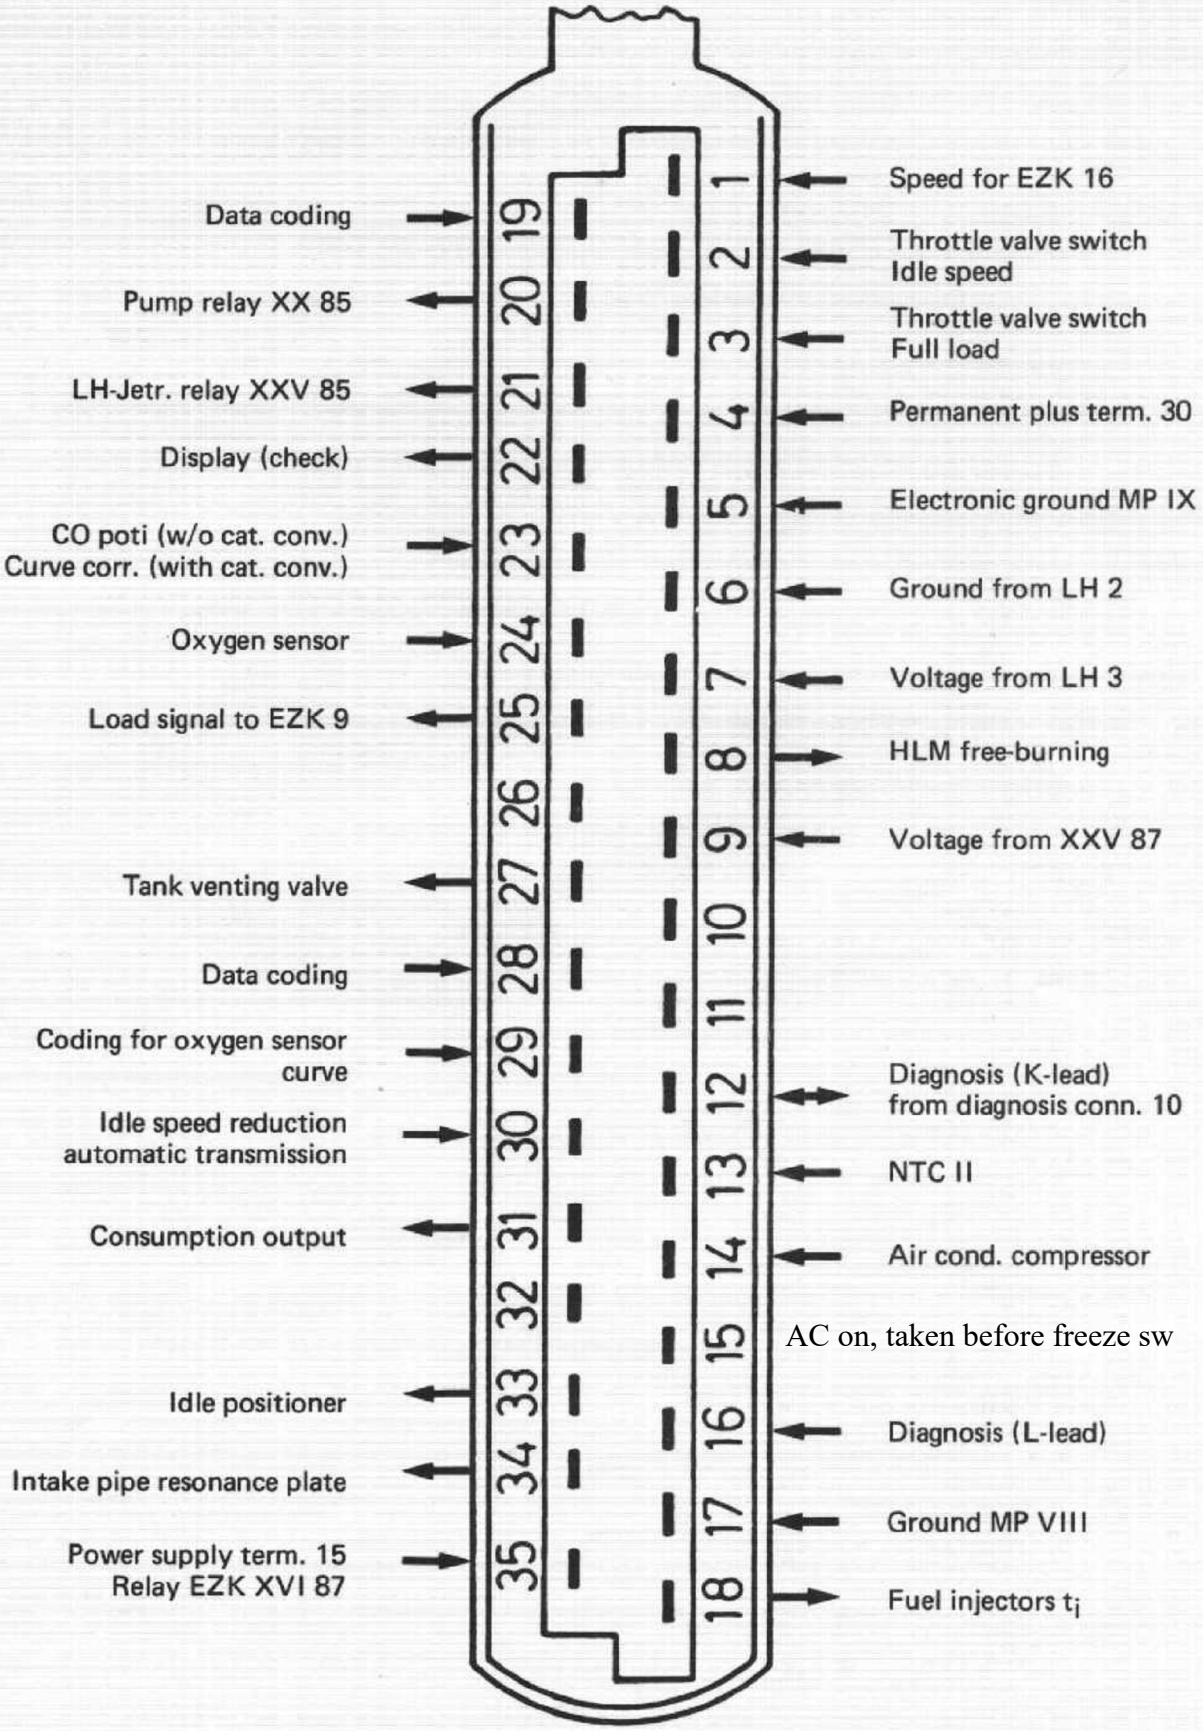
Data coding
Pump relay XX 85
LH-Jetr. relay XXV 85
Display (check)
CO poti (w/o cat. conv.)
Curve corr. (with cat. conv.)
Oxygen sensor
Load signal to EZK 9
Tank venting valve
Data coding
Coding for oxygen sensor curve
Idle speed reduction automatic transmission
Consumption output
Idle positioner
Intake pipe resonance plate
Power supply term. 15
Relay EZK XVI 87
19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18
Speed for EZK 16
Throttle valve switch Idle speed
Throttle valve switch Full load
Permanent plus term. 30
Electronic ground MP IX
Ground from LH 2
Voltage from LH 3
HLM free-burning
Voltage from XXV 87
Diagnosis (K-lead) from diagnosis conn. 10
NTC II
Air cond. compressor
AC on, taken before freeze sw
Diagnosis (L-lead)
Ground MP VIII
Fuel injectors t_i